

**Mr K. Aldred**  
**Thrislington Gulf**  
Mussafah Industrial Area  
PO Box 9547  
Abu Dhabi  
United Arab Emirates

**Review of Assessment Report Referenced WARRES No. 118193**

**1 Introduction**

The report referenced WARRES No. 118193 relates to a fire resistance test performed in accordance with Clause 8 of BS 476: Part 22: 1987, on a specimen of a single-acting, double-leaf steel doorset.

The doorset had overall nominal dimensions of 2195 mm high by 1990 mm wide and incorporated two door leaves of overall nominal dimensions 2151 mm high by 960 mm wide by 44 mm thick. The doorset was of an uninsulated, mild steel construction and incorporated a mineral fibre wool core. One door leaf was rendered inactive via flush bolts and the other leaf was latched for the duration of the test. The doorset was installed such that the door leaves opened away from the heating conditions of the test.

The performance of the specimen was judged against the criteria for integrity as specified in Clause 8 of BS 476: Part 22: 1987, and the result obtained was as follows:

Integrity : 240 minutes

**2 Confirmation of Specification**

It has been confirmed by Thrislington Gulf that there have been no changes to the specification of the doorset given within WARRES No. 118193 since the test was conducted.

### 3 Conclusions


The procedures adopted for the original test have been re-examined and are similar to those currently in use.

Therefore, with respect to the fire resistance test report referenced WARRES No. 118193, the contents should remain valid until the 1<sup>st</sup> February 2013.

### 4 Validity

This review is based on information used to formulate the original test report. No other information or data has been provided by Thrislington Gulf which could affect this review.

Performed by:

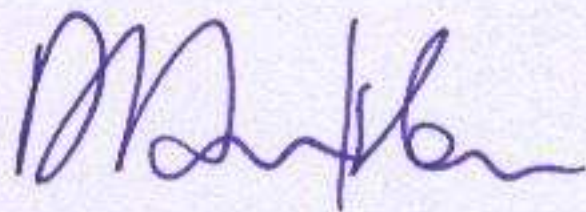

**D Hankinson**  
Technical Consultant  
Technical Department  
**Bodycote warringtonfire**

Reviewed By:



**C Johnson**  
Technical Consultant  
Technical Department  
**Bodycote warringtonfire**

**Mr K. Aldred**  
**Thrislington Gulf**  
Mussafah Industrial Area  
PO Box 9547  
Abu Dhabi  
United Arab Emirates

## Review of Assessment Report Referenced WFRC No. C122600

### **1 Introduction**

The assessment referenced **WFRC No. C122600** provides an opinion regarding the fire resistance performance of single-acting, double-leaf doorsets.

The report considers that the proposed assemblies should provide 120 minutes integrity performance, with respect to Clause 8 of BS 476: Part 22: 1987.

### **2 Confirmation of Specification**

It has been confirmed by Thrislington Gulf that there have been no changes to the specification considered in the original appraisal referenced WFRC No. C122600.

### **3 Conclusions**

The data used for the original appraisal has been re-examined and found to be satisfactory.

The procedures adopted for the original assessment have also been re-examined and are similar to those currently in use.


Therefore, with respect to the assessment of performance given in WFRC No. C122600, the contents should remain valid until the **1<sup>st</sup> June 2012.**

#### 4 Validity

This review is based on information used to formulate the original assessment. No other information or data has been provided by Thrislington Gulf which could affect this review.


The original appraisal report was performed in accordance with the principles of the UK Fire Test Study Group Resolution 82: 2001. This review has therefore also been conducted using the principles of Resolution 82: 2001.

Performed by:

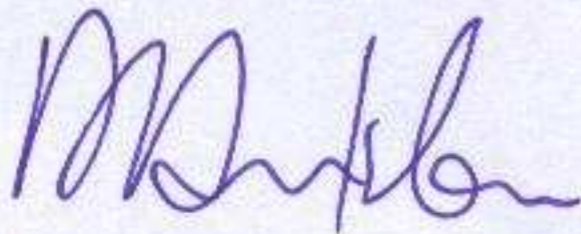

**D Hankinson**  
Technical Consultant  
Technical Department  
**Bodycote warringtonfire**

Reviewed By:

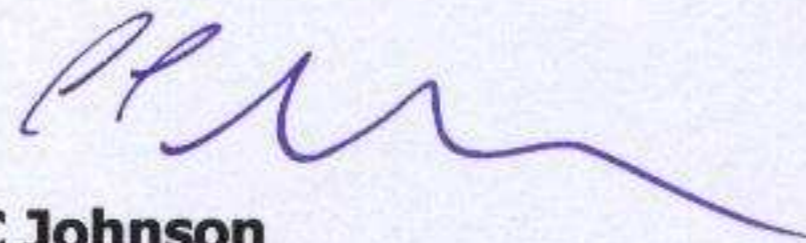

**C Johnson**  
Technical Consultant  
Technical Department  
**Bodycote warringtonfire**